


TYPICAL NOTES:

- 1)-ALL EXPOSED PIPING AND FITTINGS TO BE GALVANIZED WITH EXCEPTION OF STORZ CONNECTION
- 2)-40' MAX. FROM FDC TO FIRE APPARATUS ACCESS (DRIVEWAY)
- 3)-FOR NFPA 13R SYSTEMS (2 1/2" RISER AND SMALLER) SINGLE FDC
- 4)-FOR HIGH RISE BUILDINGS USE SIAMESE
- 5)-AN APPROVED CONNECTION (TAPPING NOT APPROVED)

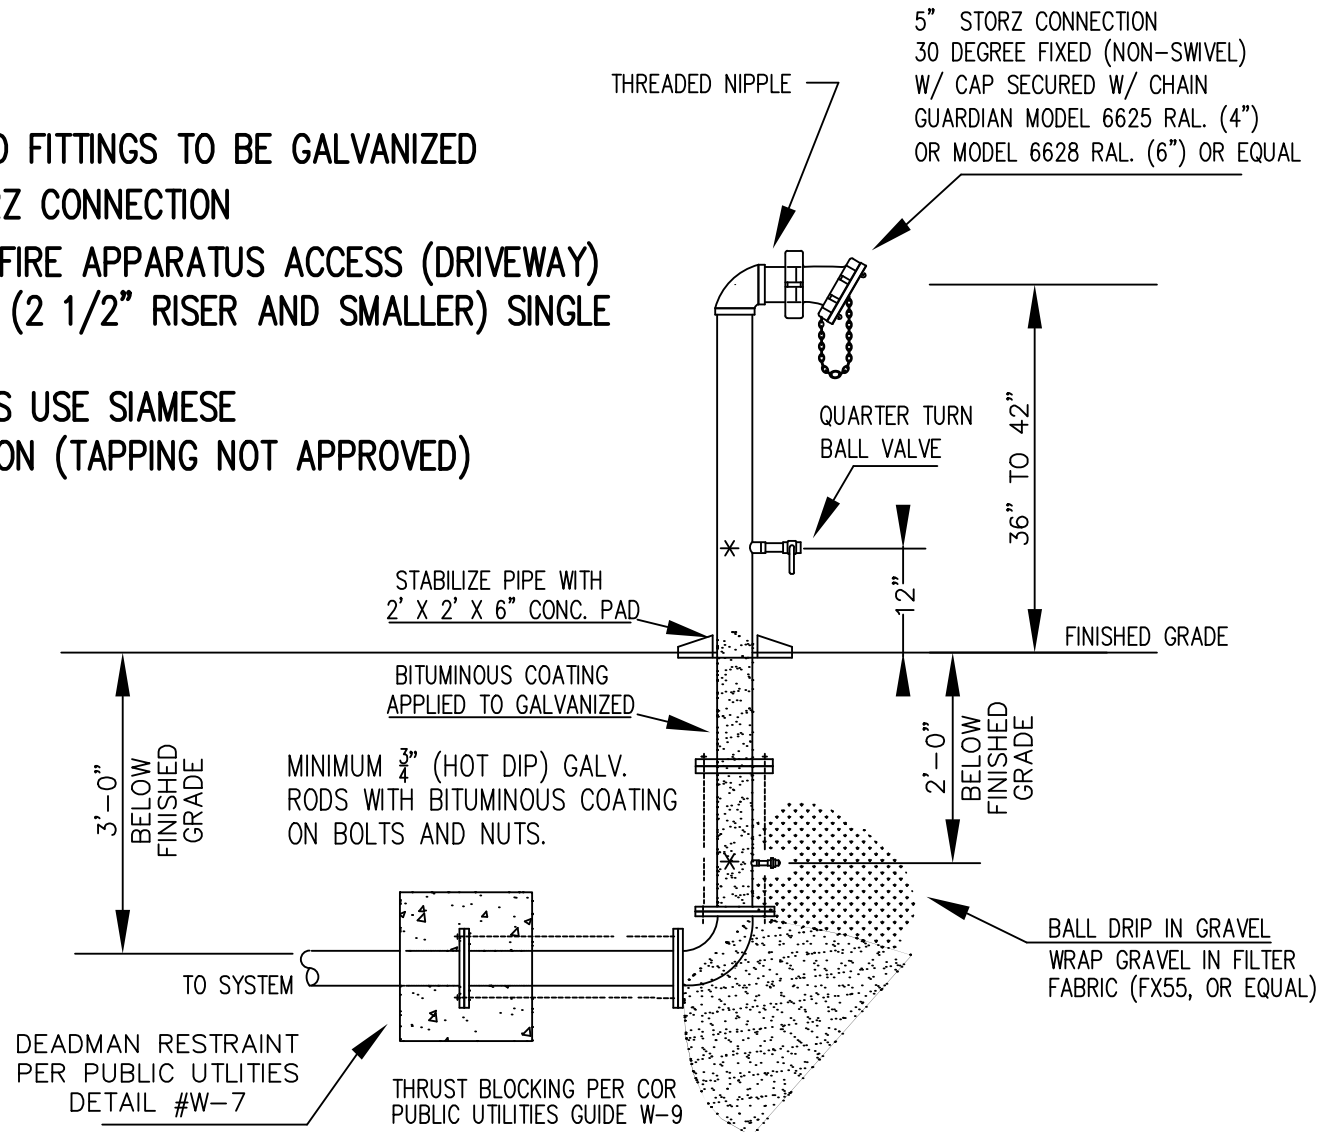

CITY OF RALEIGH FIRE DEPARTMENT
FIRE PROTECTION DIVISION
310 WEST MARTIN ST. RALEIGH, NC 27602

DESCRIPTION:
YARD FDC DETAIL REQUIREMENTS

REVISIONS:
5-1-2017

DATE:
5/1/06

DRAWING NO.
FP-15