


MAIN SIZE	END PIPE SIZE
16" & GREATER	6" MIN.
	APPROVED BY PUBLIC UTILITIES DEPT.
6" - 12"	

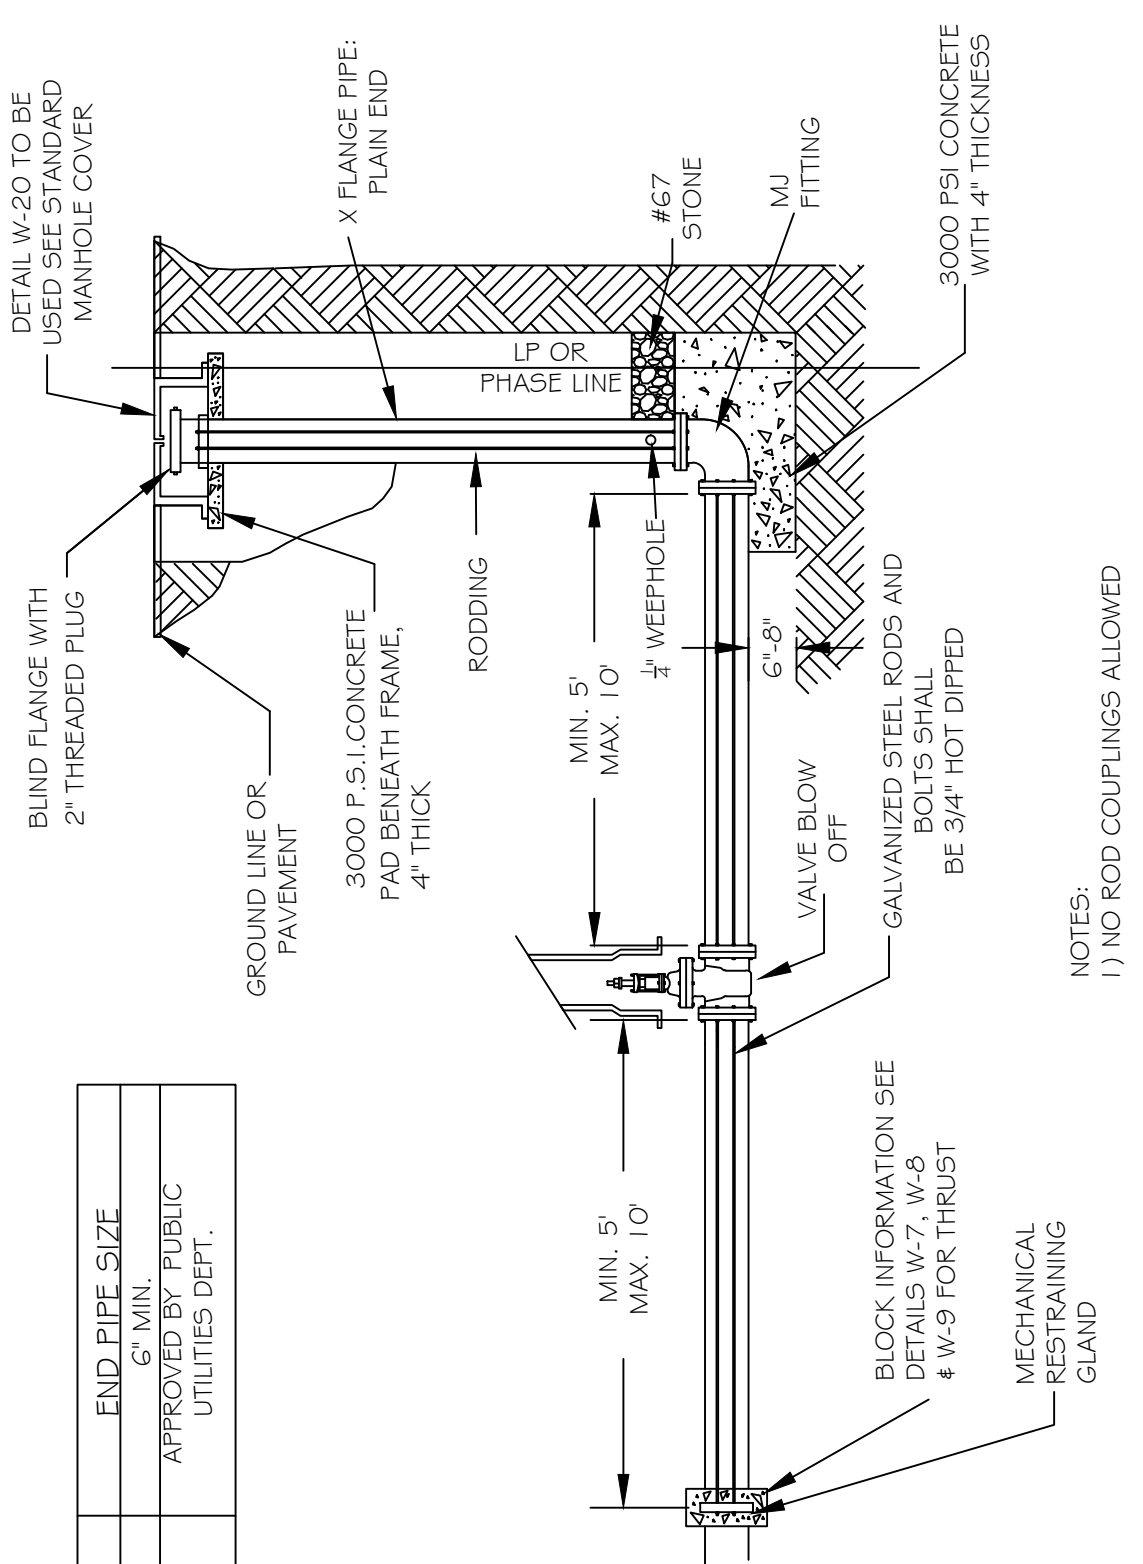

NOTES:
1) NO ROD COUPLINGS ALLOWED

CITY OF RALEIGH				
DEPARTMENT OF PUBLIC UTILITIES				
TEMPORARY WATER MAIN BLOW OFF ASSEMBLY				
DWG. NO.	REVISIONS	DATE	REVISIONS	DATE
W-21	D.W.C.	12-28-99	A.B.B.	4-12-04
	RRH	3-31-00	DHL	8-16-07