


NOTE: NO ENCASMENT REQUIRED FOR SPACE GREATER THAN 18" FOR WATER LINES

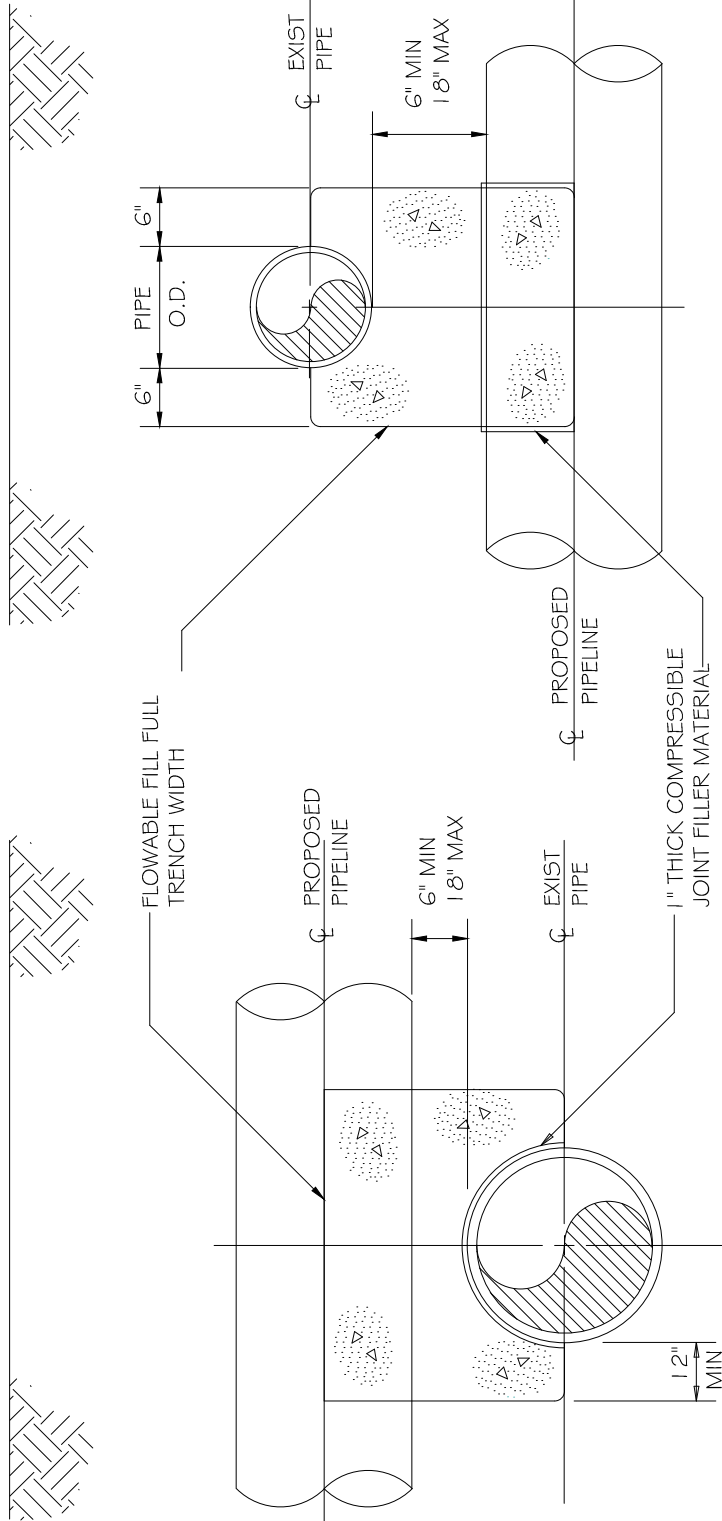

PROPOSED PIPELINE UNDER EXISTING PIPE

PROPOSED PIPELINE OVER EXISTING PIPE

CITY OF RALEIGH
DEPARTMENT OF PUBLIC UTILITIES

CONCRETE CRADLE PROTECTION FOR WATER LINE CROSSINGS

DWG. NO.	REVISIONS	DATE	REVISIONS	DATE
W-41	DHL	2-20-08		